



# i-Vu® Building Automation System VAV Zone II Fan Terminal

Part Number: OPN-VAVB3-02



*The i-Vu® Building Automation System provides everything you need to access, manage, and control your building, including the powerful i-Vu user interface, plug-and-play BACnet controllers, and state-of-the-art Carrier equipment.*

The VAV Zone II Fan Terminal controller provides zone level temperature and air quality control for a variety of pressure-independent VAV applications. This advanced controller features a separable actuator for easy installation onto fan-powered or single-duct air terminals. It also features native BACnet communications and plug-and-play connectivity to the Carrier i-Vu Building Automation System.

## Application Features


- Sophisticated factory-engineered and tested control programs provide reliability and energy efficiency
- Pressure independent space temperature control
- Supports modulating hot water, 2-position hot water, single, 2, or 3 stage electric heat, or zone perimeter heat
- Built-in advanced control routines for zone level humidity control or zone level demand control ventilation (ASHRAE® 62)
- Adaptive optimal start and PID control for maximum occupant comfort
- Supports Carrier communicating space sensors, which allow for local setpoint adjustment and local overrides
- Quick and easy test & balancing process

## System Benefits


- Integrated Carrier airside linkage algorithm for plug-and-play integration with Carrier air sources
- Fully plug-and-play with the Carrier i-Vu Building Automation System
- Supports demand limiting for maximum energy savings
- Compatible with i-Vu Tenant Billing for tracking tenants' after-hours energy usage

## Hardware Features

- Separable brushless actuator for reliability and longevity
- Capable of system or stand-alone operation
- Native BACnet MS/TP or ARCNET communications

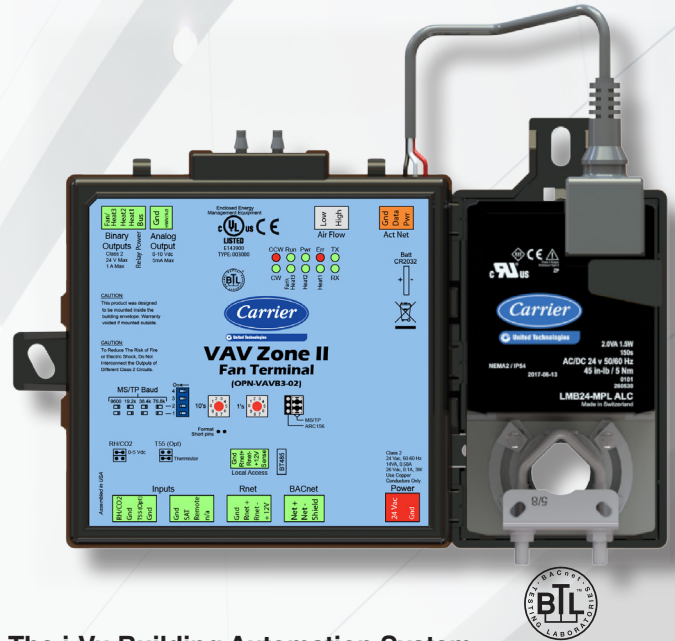

## The i-Vu Building Automation System

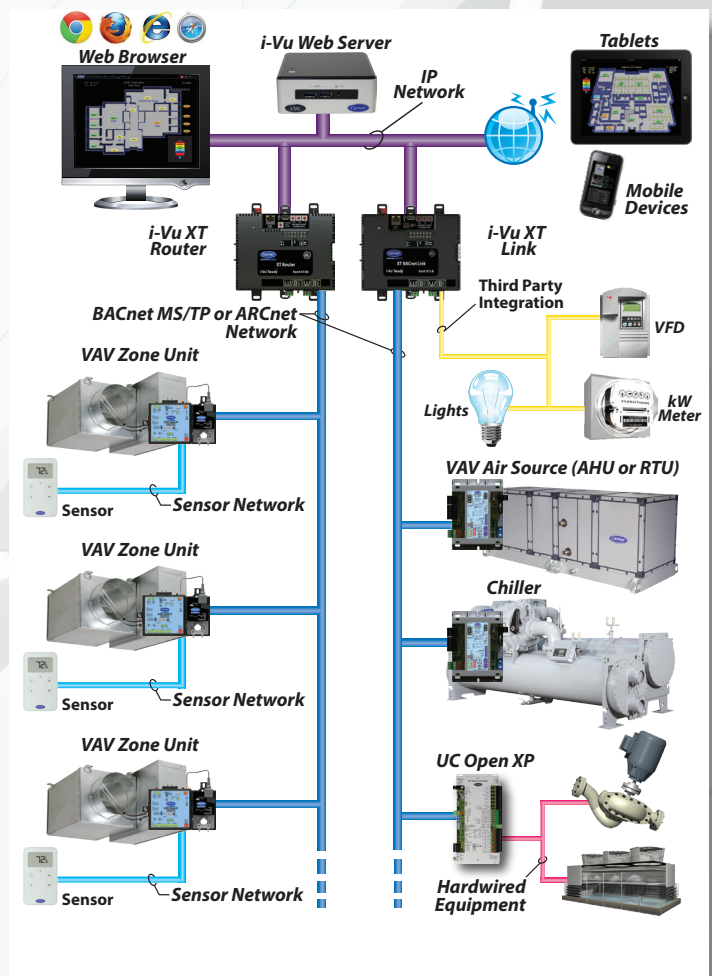



# i-Vu® Building Automation System VAV Zone II Fan Terminal

Part Number: OPN-VAVB3-02

<b>BACnet Support</b>	Advanced Application Controller (B-AAC), as defined in BACnet 135-2012 Annex L Protocol rev. 9
<b>Communication Ports</b>	<b>BACnet port:</b> EIA-485 port for BACnet MS/TP communications (9600 bps, 19.2 kbps, 38.4 kbps, & 76.8 kbps) or ARCNET 156 kbps; <b>Local Access port:</b> For system start-up and troubleshooting (115.2 kbps); <b>Rnet port:</b> For connecting Carrier communicating room sensors and Carrier's touchscreen user interface <b>ACTnet Port:</b> For connecting the actuator cable
<b>Separable Actuator</b>	Brushless DC motor, torque 45 inch-pounds (5Nm), runtime 205 seconds for 90 degree travel during control
<b>Integral Pressure Sensor</b>	Precision low flow AWM series 0–2 in. H <sub>2</sub> O, sensitive down to ±0.001 in. H <sub>2</sub> O. Barbed tapered airflow connections accept 3/16 in. (4.75 mm) I.D. tubing. Allows for readings across the 0–2 in. H <sub>2</sub> O range, accurate to ±5% of full flow at 2 in. H <sub>2</sub> O
<b>Inputs</b>	<b>3 analog inputs:</b> RH/CO <sub>2</sub> (0-5V), T55 (10k thermistor), SAT (10k thermistor). AI's have 10 bit A/D resolution. <b>1 binary input:</b> Remote Occupancy (dry contact).
<b>Outputs</b>	<b>1 analog output:</b> Hot Water Valve/Actuator (HWV/ACT). AO is 0 to 10VDC (5mA maximum) with 8 bit D/A resolution using filtered PWM. <b>3 binary outputs:</b> HEAT1, HEAT2, and FAN/HEAT3. Relay contacts rated at 1A max @ 24VAC/VDC, configured normally open.
<b>Protection</b>	Incoming power and network connections are protected by non-replaceable internal solid state polyswitches that reset themselves when the condition that causes a fault returns to normal. The power, network, input, and output connections are also protected against voltage transient and surge events lasting no more than 10 msec.
<b>Battery</b>	10-year Lithium CR2032 battery provides a minimum of 10,000 hours of trend data retention during power outages
<b>Status Indicators</b>	LED status indicators for BACnet communication, run status, error, power, and all digital outputs
<b>Controller Addressing</b>	Rotary DIP switches set BACnet MS/TP or ARCNET address
<b>Listed by</b>	UL-916 (PAZX), cUL-916 (PAZX7), FCC Part15-Subpart B-Class A, CE EN50082-1997, UL94-5VA plenum rated enclosure
<b>Environmental Operating Range</b>	<b>Operating:</b> 32 to 130°F (0 to 54°C) 10 to 90% RH, non-condensing <b>Storage:</b> -24 to 140°F (-30 to 60°C) 0 to 90% RH, non-condensing
<b>Power Requirements</b>	24VAC ± 10%, 50-60Hz, 14 VA power consumption 26VDC (25V min, 30V max), Single Class 2 source only, 100 VA or less

## Dimensions

### Overall

**A:** 5.10" (12.95 cm)  
**B:** 8.93" (22.68 cm)  
**C:** 5.87" (14.90 cm)

### Mounting

**D:** 7.00" (17.78 cm)  
**E:** 4.89" (12.42 cm)  
**F:** 1.04" (2.64 cm)  
**G:** 1.46" (3.71 cm)  
**H:** 2.55" (6.48 cm)  
**I:** 0.58" (1.47 cm)


**Depth:** 2.5" (6.4 cm)

**Weight:** 1.8 lbs (0.82 kg)

**Minimum Shaft Diameter:** 3/8" (.95 cm)

**Maximum Shaft Diameter:** 1/2" (1.27 cm)

**Minimum Shaft Length:** 1-3/4" (4.45 cm)

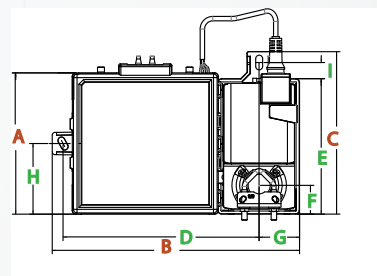

CONTROLS EXPERT

Tested. Certified. Factory Authorized.

For more information, contact  
your local Carrier Controls Expert.

Controls Expert Locator:  
[www.carrier.com/controls-experts](http://www.carrier.com/controls-experts)

© Carrier Corporation Cat. No. 11-808-471-01 Rev. 11/18  
Manufacturer reserves the right to discontinue, or change at any time, specifications or designs, without notice and without incurring obligations. Trademarks are properties of their respective companies and are hereby acknowledged.